

# TUFF-RIB 29 GA. LOAD TABLE OVER 1x4 WOOD PURLINS


# GULF COAST

Buildings having a Roof Mean Height  $\leq$  20'-0"; Roof Slope: 2"/12" - 6"/12" Gable Roof  
Wind Speeds 110-140 mph, Exp C, I = 1.0, based on FLORIDA BUILDING CODE 2007



TUFF-RIB 29 GA. FASTENER SPACING						
ZONE	FASTENER	SUBSTRATE	WIND SPEED ZONE			
			110	120	130	140
			ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING
ZONE 1	#9-15 x 1-1/2"	1x4 WOOD PURLINS	24" TYPE 1	24" TYPE 1	24" TYPE 1	24" TYPE 1
ZONE 2	#9-15 x 1-1/2"	1x4 WOOD PURLINS	24" TYPE 1	24" TYPE 1	24" TYPE 1	24" TYPE 1
ZONE 3	#9-15 x 1-1/2"	1x4 WOOD PURLINS	24" TYPE 2	24" TYPE 2	24" TYPE 2	24" TYPE 2

- PANEL DESCRIPTION:** TUFF RIB, MIN. 29 GA., 3/4" TALL RIB, 36" WIDTH.
- PANEL FASTENER:** #9-15 x 1-1/2" HWH W/ WASHER.
- PANEL ROLLFORMER:** MRS METAL ROLLFORMING SYSTEMS.
- MAXIMUM ALLOWABLE PANEL UPLIFT PRESSURE:** 76.75 PSF @ 24" O.C. TYPE 1 FASTENER PATTERN, 123.5 @ 24" O.C. TYPE 2 FASTENER PATTERN BASED ON UL 580/UL 1897 TESTING BY FORCE ENGINEERING TEST REPORT #117-0033T-05 & 117-0331T-08B.
- PLYWOOD DECKING:** 1x4 WOOD PURLINS OVER MIN. 15/32" THICK PLYWOOD. MUST BE DESIGNED IN ACCORDANCE WITH FBC 2007.

**TYPE 1 FASTENER PATTERN**

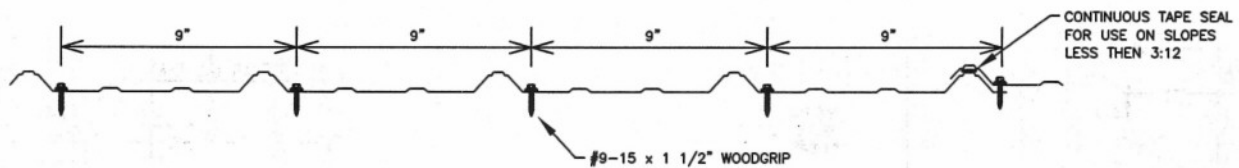

**TYPE 2 FASTENER PATTERN**

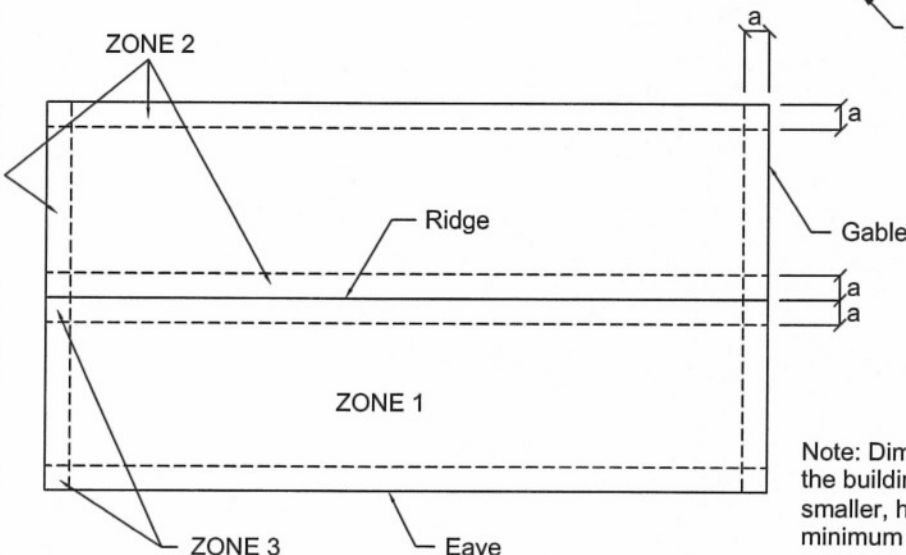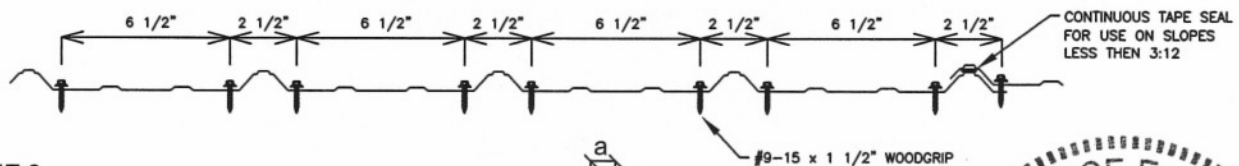

State of Florida  
C.O.A.  
# 26778



NOV 08 2008

Note: Dimension (a) is defined as 10% of the minimum width of the building or 40% of the mean height of the roof, whichever is smaller, however, (a) cannot be less than either 4% of the minimum width of the building or 3 feet.