

# 5V CRIMP 26 GA. LOAD TABLE OVER PLYWOOD

# GULF COAST

Buildings having a Roof Mean Height  $\leq$  20'-0"; Roof Slope: 2"/12" - 6"/12" Gable Roof  
Wind Speeds 120-150 mph, Exp C, I = 1.0, based on FLORIDA BUILDING CODE 2007

| 5 V CRIMP 26 GA. FASTENER SPACING |              |                           |                   |                   |                   |                   |
|-----------------------------------|--------------|---------------------------|-------------------|-------------------|-------------------|-------------------|
| ZONE                              | FASTENER     | SUBSTRATE                 | WIND SPEED ZONE   |                   |                   |                   |
|                                   |              |                           | 120               | 130               | 140               | 150               |
|                                   |              |                           | ON CENTER SPACING | ON CENTER SPACING | ON CENTER SPACING | ON CENTER SPACING |
| ZONE 1                            | #9-15-1-1/2" | 15/32" CDX/<br>19/32" CDX | 12"               | 12"               | 12"               | 12"               |
| ZONE 2                            | #9-15-1-1/2" | 15/32" CDX/<br>19/32" CDX | 12"               | 12"               | 12"               | 12"               |
| ZONE 3                            | #9-15-1-1/2" | 15/32" CDX/<br>19/32" CDX | 6"                | 6"                | 6"                | 6"                |

**PANEL DESCRIPTION:** 5V CRIMP, MIN. 26 GA., 24" COVERAGE, 3/8" TALL.


**PANEL FASTENER:** (1) #9-15 x 1-1/2" WOODGRIP W/ ZAC HEAD AND SEALING WASHER THROUGH RIB OF PANEL.

**MAXIMUM ALLOWABLE PANEL UPLIFT PRESSURE:** 108.5 PSF @ 12" FASTENER SPACING, 156.5 PSF @ 6" FASTENER SPACING BASED ON TAS 125, UL 580/UL 1897 TESTING.

**PLYWOOD DECKING:** MIN. 15/32" PLYWOOD. PLYWOOD MUST BE DESIGNED IN ACCORDANCE WITH FBC.

**PANEL ROLLFORMER:** MODEL 5V BY ROLL FORMER CORP

(1) #9-15 x 1 1/2 WOODGRIP w/ ZAC HEAD & SEALING WASHER

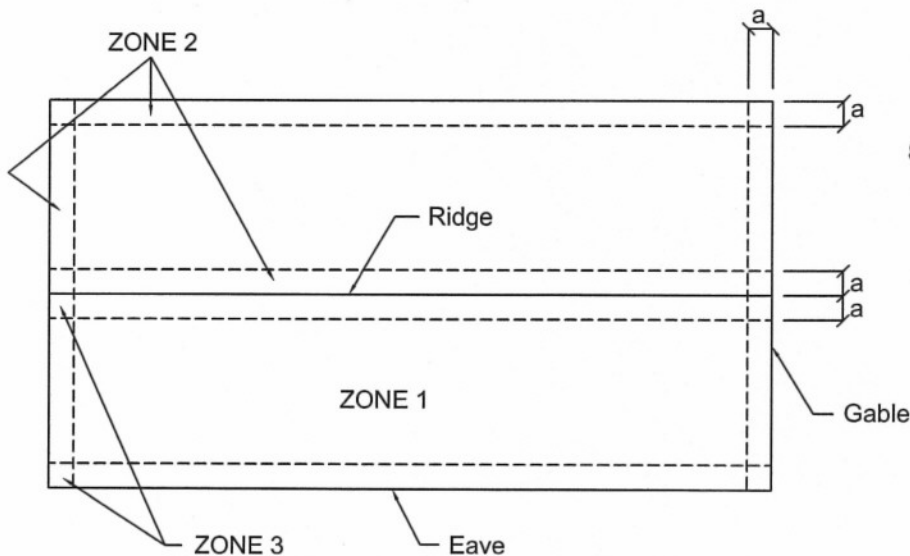

State of Florida  
C.O.A.  
# 26778



November 8, 2008

Note: Dimension (a) is defined as 10% of the minimum width of the building or 40% of the mean height of the roof, whichever is smaller, however, (a) cannot be less than either 4% of the minimum width of the building or 3 feet.