

24 GA. GULF LOK 16" WIDE LOAD TABLE OVER PLYWOOD



GULF COAST

Buildings having a Roof Mean Height \leq 20'-0"; Roof Slope: 3"/12" -6"/12" Gable Roof
Wind Speeds 100-130 mph, Exp C, I = 1.0, based on FLORIDA BUILDING CODE 2007

GULF LOK 24 GA. FASTENER SPACING						
ZONE	FASTENER	SUBSTRATE	WIND SPEED ZONE			
			100	110	120	130
			ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING
ZONE 1	#10 x 1" TYPE A	15/32" CDX/ 19/32" CDX	10.25"	10.25"	10.25"	10.25"
ZONE 2	#10 x 1" TYPE A	15/32" CDX/ 19/32" CDX	10.25"	10.25"	10.25"	10.25"
ZONE 3	#10 x 1" TYPE A	15/32" CDX/ 19/32" CDX	5.125"	5.125"	5.125"	5.125"

- PANEL DESCRIPTION:** GULF LOK, MIN. 24 GA., $\frac{7}{8}$ " RIB, 16" MAX WIDTH, SNAP SEAM.
- PANEL FASTENER:** (1) #10-12 x 1" TYPE A PANCAKE HEAD.
- PANEL ROLLFORMER:** NEW TECH MACHINE.
- MAXIMUM ALLOWABLE PANEL UPLIFT PRESSURE:** 81.75 PSF @ 10-1/4" O.C., 96.75 PSF @ 5-1/8" PRESSURE BASED ON UL 580/UL 1897 TESTING BY FORCE ENGINEERING TEST REPORT #117-0089T-05.
- PLYWOOD DECKING:** MIN. 15/32" THICK, APA RATED PLYWOOD, GRADE C-D, PLYWOOD. MUST BE DESIGNED IN ACCORDANCE WITH FBC 2007.

16" COVERAGE

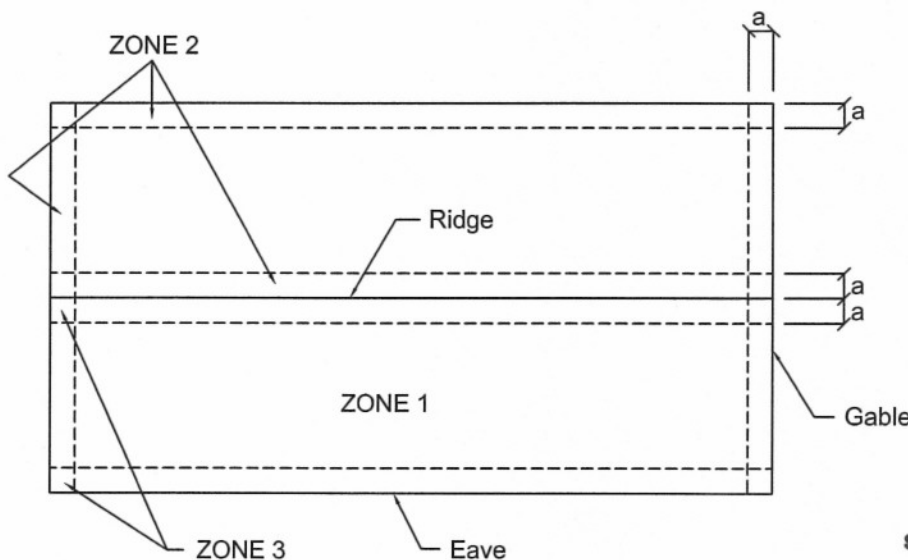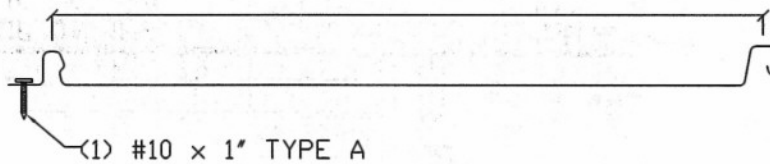

Note: Dimension (a) is defined as 10% of the minimum width of the building or 40% of the mean height of the roof, whichever is smaller, however, (a) cannot be less than either 4% of the minimum width of the building or 3 feet.



State of Florida
C.O.A.
28778

NOV 08 2008